


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:220.09V I:0.1181A P:12.560W PF:0.4833 Freq:50.00Hz Lamp Flux:668.969x1 lm		
NAME: EBM104-08EL-SC30BK	TYPE:固定式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 53.26 lm/W			
MODEL		Imax(cd)	174.2	S/MH(C0/180)	3.03
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	3.05
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	668.97	η UP,DN(C0-180)	0.1,50.2
NOMINAL FLUX(lm)	668.969	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,49.6
LAMPS INSIDE	1	η up(%)	0.2	CIBSE SHR NOM	1.00
TEST VOLTAGE(V)	220	η down(%)	99.8	CIBSE SHR MAX	1.15

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM



C0 PLANE ISOLUX DIAGRAM (UNIT:lx)



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.459m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	139.6	140.8	139.5	140.7	136.9	137.1	133.5	131.7	0- 10	9.647	9.647	1.44,1.44
20	170.3	169.2	168.8	169.8	169.2	170.9	171.1	163.6	10- 20	45.71	55.36	8.28,8.28
30	172.6	172.6	171.6	169.9	168.9	171.9	173.9	165.6	20- 30	78.62	134.0	20,20
40	170.8	171.8	168.8	165.1	163.4	167.3	170.1	161.9	30- 40	106.4	240.4	35.9,35.9
50	159.7	159.4	154.9	151.6	153.1	155.0	157.5	149.1	40- 50	125.4	365.8	54.7,54.7
60	137.0	140.5	136.6	131.0	130.4	133.4	132.1	123.5	50- 60	130.2	496.0	74.1,74.1
70	90.88	89.86	85.99	84.60	82.07	86.01	87.85	81.46	60- 70	110.9	606.9	90.7,90.7
80	18.65	16.92	16.13	15.28	17.47	18.44	22.30	22.48	70- 80	54.14	661.0	98.8,98.8
90	0.1769	0.1838	0.1991	0.1635	0.2278	0.2453	0.2659	0.2214	80- 90	6.926	667.9	99.8,99.8
100	0.0950	0.1059	0.1146	0.0866	0.1269	0.1255	0.1103	0.0827	90-100	0.1591	668.1	99.9,99.9
110	0.0857	0.0991	0.1024	0.0848	0.1042	0.1075	0.0914	0.0752	100-110	0.1025	668.2	99.9,99.9
120	0.1188	0.1285	0.1280	0.1178	0.1353	0.1433	0.1302	0.1158	110-120	0.1084	668.3	99.9,99.9
130	0.1562	0.1658	0.1605	0.1541	0.1954	0.2054	0.1934	0.1812	120-130	0.1362	668.4	99.9,99.9
140	0.1910	0.1960	0.1933	0.1901	0.2510	0.2617	0.2549	0.2433	130-140	0.1552	668.6	99.9,99.9
150	0.2352	0.2393	0.2363	0.2361	0.2925	0.3037	0.2996	0.2856	140-150	0.1539	668.7	100,100
160	0.2660	0.2663	0.2683	0.2674	0.3012	0.3070	0.3033	0.2960	150-160	0.1301	668.9	100,100
170	0.1946	0.1913	0.1927	0.1927	0.2180	0.2192	0.2181	0.2187	160-170	0.0726	668.9	100,100
180	0.2105	0.2033	0.2094	0.2108	0.2084	0.2062	0.2081	0.2099	170-180	0.0196	669.0	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 301.54 lm

%lum = 45.1%

%lamp = 45.1%

Conical surface Flux(120deg): 495.99 lm


%lum = 74.1%

%lamp = 74.1%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.459m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES




C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.459m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.03	.98	.94	1.01	.97	.93	.96	.93	.90	.92	.90	.87	.89	.87	.84	.82
2.0	.88	.81	.75	.86	.80	.74	.83	.77	.72	.79	.75	.70	.76	.72	.69	.67
3.0	.76	.68	.61	.75	.67	.60	.72	.65	.59	.69	.63	.58	.66	.61	.57	.54
4.0	.67	.57	.50	.65	.56	.50	.63	.55	.49	.60	.53	.48	.58	.52	.47	.45
5.0	.59	.49	.42	.58	.48	.42	.55	.47	.41	.53	.46	.41	.51	.45	.40	.38
6.0	.52	.43	.36	.51	.42	.36	.49	.41	.35	.48	.40	.35	.46	.39	.34	.32
7.0	.47	.37	.31	.46	.37	.31	.44	.36	.31	.43	.36	.30	.41	.35	.30	.28
8.0	.42	.33	.27	.42	.33	.27	.40	.32	.27	.39	.32	.27	.38	.31	.26	.24
9.0	.38	.30	.24	.38	.30	.24	.37	.29	.24	.36	.29	.24	.34	.28	.23	.21
10.0	.35	.27	.21	.35	.27	.21	.34	.26	.21	.33	.26	.21	.32	.25	.21	.19



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:

WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.325	.185	.059	.318	.182	.058	.305	.175	.056	.292	.169	.054	.281	.163	.053	
2.0	.311	.171	.052	.305	.168	.052	.293	.163	.051	.282	.158	.050	.272	.154	.048	
3.0	.289	.154	.046	.283	.152	.046	.273	.148	.045	.263	.144	.044	.254	.141	.043	
4.0	.267	.139	.041	.262	.137	.040	.252	.134	.040	.243	.131	.039	.235	.128	.039	
5.0	.246	.125	.036	.241	.124	.036	.233	.121	.036	.225	.119	.035	.218	.116	.035	
6.0	.227	.114	.033	.223	.113	.032	.216	.111	.032	.209	.108	.032	.202	.106	.032	
7.0	.211	.104	.030	.207	.103	.029	.201	.101	.029	.194	.100	.029	.188	.098	.029	
8.0	.196	.096	.027	.193	.095	.027	.187	.093	.027	.181	.092	.027	.176	.090	.026	
9.0	.183	.089	.025	.181	.088	.025	.175	.087	.025	.170	.085	.024	.165	.084	.024	
10.0	.172	.082	.023	.169	.082	.023	.164	.081	.023	.160	.079	.023	.155	.078	.022	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.183	.157	.134	.156	.135	.116	.107	.093	.080	.062	.054	.046	.020	.017	.015	
2.0	.176	.133	.097	.151	.115	.084	.103	.079	.058	.060	.046	.034	.019	.015	.011	
3.0	.169	.116	.073	.145	.100	.063	.100	.069	.044	.058	.040	.026	.018	.013	.009	
4.0	.162	.103	.057	.139	.089	.049	.096	.062	.035	.055	.036	.021	.018	.012	.007	
5.0	.155	.092	.046	.133	.080	.040	.092	.056	.028	.053	.033	.017	.017	.011	.006	
6.0	.148	.084	.038	.127	.073	.033	.088	.051	.024	.051	.030	.014	.016	.010	.005	
7.0	.141	.077	.033	.121	.067	.029	.084	.047	.020	.049	.028	.012	.016	.009	.004	
8.0	.135	.072	.029	.116	.062	.025	.080	.044	.018	.047	.026	.011	.015	.008	.003	
9.0	.128	.067	.025	.110	.058	.022	.077	.041	.016	.045	.024	.009	.014	.008	.003	
10.0	.122	.063	.023	.105	.054	.020	.073	.038	.014	.043	.023	.008	.014	.007	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.6	24.3	22.9	24.5	24.7	22.6	24.2	22.9	24.4	24.7
3H	24.5	26.0	24.8	26.3	26.5	24.4	25.9	24.7	26.1	26.4
4H	25.1	26.5	25.4	26.8	27.0	24.8	26.3	25.1	26.5	26.8
6H	25.2	26.5	25.5	26.8	27.1	24.9	26.3	25.2	26.5	26.8
8H	25.2	26.5	25.5	26.8	27.1	24.9	26.2	25.2	26.5	26.8
12H	25.1	26.4	25.5	26.7	27.0	24.8	26.1	25.2	26.4	26.7
4H 2H	23.4	24.9	23.7	25.1	25.4	23.4	24.8	23.7	25.1	25.4
3H	25.4	26.7	25.8	27.0	27.3	25.3	26.5	25.6	26.8	27.1
4H	26.0	27.1	26.4	27.5	27.8	25.8	26.9	26.2	27.2	27.6
6H	26.2	27.2	26.6	27.5	27.9	25.9	26.9	26.3	27.3	27.6
8H	26.2	27.1	26.6	27.5	27.9	25.9	26.8	26.3	27.2	27.6
12H	26.2	27.0	26.6	27.4	27.8	25.9	26.7	26.3	27.1	27.5
8H 4H	26.1	27.1	26.6	27.5	27.9	25.9	26.9	26.4	27.3	27.7
6H	26.4	27.2	26.8	27.6	28.0	26.1	26.9	26.6	27.3	27.7
8H	26.4	27.1	26.9	27.5	28.0	26.1	26.8	26.6	27.3	27.7
12H	26.4	27.0	26.9	27.5	27.9	26.1	26.7	26.6	27.2	27.7
12H 4H	26.1	27.0	26.6	27.4	27.8	25.9	26.8	26.3	27.2	27.6
6H	26.4	27.1	26.8	27.5	27.9	26.1	26.8	26.6	27.2	27.7
8H	26.4	27.0	26.9	27.5	27.9	26.2	26.7	26.6	27.2	27.7
Variations with the observer position at spacings:										
S = 1.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.2				
1.5H	+ 0.2 / - 0.4					+ 0.3 / - 0.4				
2.0H	+ 0.2 / - 0.6					+ 0.3 / - 0.7				

CIE Pub.117, 669.0 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = -1.4$)

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	52	40	32	52	40	32	50	39	32	25
0.80	63	50	42	62	50	42	60	49	41	34
1.00	72	60	52	70	59	51	68	61	51	43
1.25	79	68	60	78	67	60	75	66	59	51
1.50	85	74	66	83	73	66	80	71	65	57
2.00	93	83	76	91	82	75	87	80	74	66
2.50	97	89	82	95	87	81	91	84	79	70
3.00	101	93	87	99	92	86	94	89	84	75
4.00	105	99	94	103	97	93	98	94	90	81
5.00	108	103	99	105	101	97	101	97	94	85
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.459m [K=1.0000]
Remarks:


AAI Figure

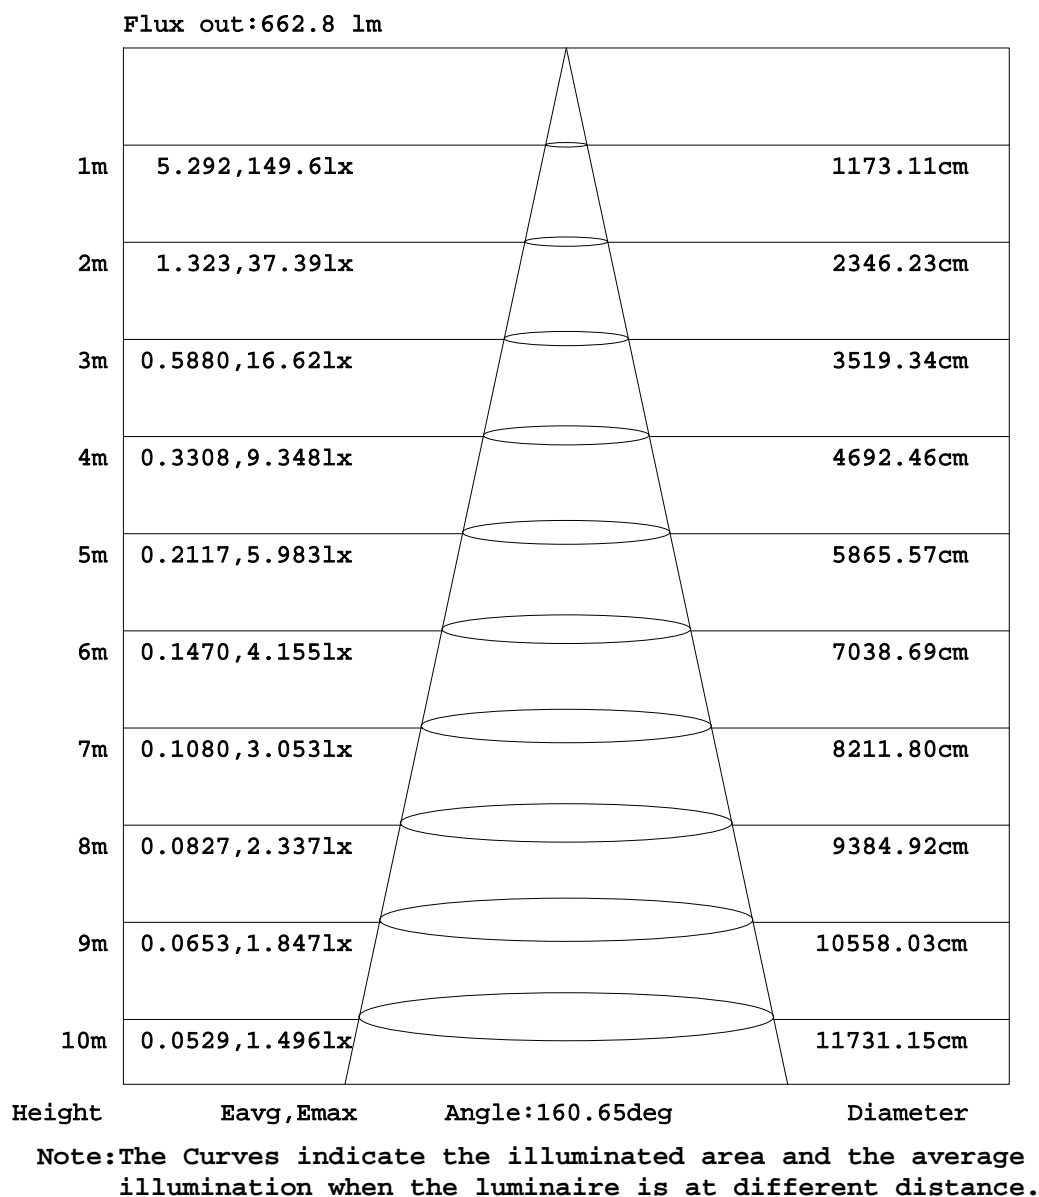

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM



C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.09V I:0.1181A P:12.560W PF:0.4833 Freq:50.00Hz Lamp Flux:668.969x1 lm		
NAME: EBM104-08EL-SC30BK	TYPE:固定式灯具	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: WAC Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	8987
L_0~180(75)av	6541
L_0~180(85)av	1900
L_90~270(65)av	8973
L_90~270(75)av	6646
L_90~270(85)av	1979
L_45(65)av	8818
L_45(75)av	6471
L_45(85)av	1906

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.2DEG
 Operators:Oliver
 Test Date:2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:65.0%
 Test Distance:2.459m [K=1.0000]
 Remarks:

Planar Illuminance Curve



C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.2DEG
Operators: Oliver
Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 65.0%
Test Distance: 2.459m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6			
5	87.6	88.8	89.1	89.2	89.9	90.4	89.6	87.7	76.4	75.6	75.6	76.4	76.6	75.4	74.9	76.8			
10	140	141	141	141	139	140	141	141	137	137	137	136	133	131	132	130			
15	165	165	165	164	164	165	165	166	164	164	165	166	163	152	158	156			
20	170	170	169	169	169	169	170	170	169	170	171	172	171	161	164	162			
25	172	172	171	170	170	170	170	170	169	170	172	173	174	166	165	164			
30	173	173	173	172	172	170	170	170	169	170	172	173	174	169	166	164			
35	172	173	173	173	171	169	168	168	167	168	171	172	173	169	164	164			
40	171	171	172	171	169	166	165	165	163	164	167	169	170	167	162	162			
45	167	167	167	166	163	160	159	159	159	160	162	164	165	163	157	160			
50	160	160	159	158	155	152	152	153	153	154	155	157	157	156	149	153			
55	150	151	152	151	148	144	142	143	144	145	146	147	147	145	138	144			
60	137	139	140	140	137	132	131	130	130	132	133	132	132	131	123	131			
65	118	119	119	117	114	111	111	109	110	112	113	113	113	112	104	114			
70	90.9	91.2	89.9	88.0	86.0	85.0	84.6	81.2	82.1	83.3	86.0	87.1	87.9	88.8	81.5	88.9			
75	54.0	52.9	50.7	48.5	47.9	47.8	46.5	45.8	47.6	47.8	50.2	53.8	55.3	57.4	53.5	57.2			
80	18.7	17.6	16.9	16.3	16.1	16.0	15.3	15.8	17.5	17.4	18.4	19.6	22.3	22.8	22.5	22.8			
85	5.19	4.88	4.62	4.33	4.12	4.05	3.93	3.95	4.75	4.98	5.49	5.96	6.23	6.25	5.90	6.00			
90	0.18	0.18	0.18	0.19	0.20	0.21	0.16	0.21	0.23	0.23	0.25	0.26	0.27	0.26	0.22	0.24			
95	0.12	0.13	0.13	0.14	0.15	0.15	0.11	0.16	0.17	0.17	0.16	0.15	0.14	0.13	0.11	0.13			
100	0.09	0.10	0.11	0.11	0.11	0.12	0.09	0.12	0.13	0.13	0.13	0.12	0.11	0.10	0.08	0.09			
105	0.08	0.09	0.10	0.10	0.10	0.10	0.08	0.10	0.11	0.11	0.11	0.10	0.09	0.08	0.07	0.08			
110	0.09	0.09	0.10	0.10	0.10	0.10	0.08	0.10	0.10	0.11	0.11	0.10	0.09	0.08	0.08	0.08			
115	0.10	0.11	0.11	0.12	0.11	0.11	0.10	0.11	0.11	0.12	0.12	0.11	0.11	0.10	0.09	0.09			
120	0.12	0.12	0.13	0.13	0.13	0.13	0.12	0.13	0.14	0.15	0.14	0.14	0.13	0.12	0.12	0.12			
125	0.14	0.14	0.15	0.15	0.15	0.14	0.14	0.15	0.16	0.17	0.17	0.17	0.16	0.15	0.15	0.15			
130	0.16	0.16	0.17	0.17	0.16	0.16	0.15	0.16	0.20	0.21	0.21	0.20	0.19	0.19	0.18	0.18			
135	0.17	0.18	0.18	0.19	0.18	0.17	0.17	0.18	0.23	0.24	0.23	0.23	0.23	0.22	0.22	0.21			
140	0.19	0.19	0.20	0.20	0.19	0.19	0.19	0.19	0.25	0.26	0.26	0.26	0.25	0.25	0.24	0.24			
145	0.21	0.21	0.22	0.22	0.21	0.21	0.21	0.21	0.28	0.29	0.29	0.28	0.28	0.28	0.27	0.26			
150	0.24	0.24	0.24	0.24	0.24	0.23	0.24	0.24	0.29	0.30	0.30	0.30	0.30	0.30	0.29	0.28			
155	0.26	0.26	0.26	0.27	0.26	0.26	0.26	0.26	0.31	0.31	0.31	0.31	0.31	0.31	0.30	0.30			
160	0.27	0.27	0.27	0.27	0.27	0.27	0.27	0.27	0.30	0.30	0.31	0.30	0.30	0.31	0.30	0.29			
165	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.28	0.28	0.28	0.28	0.28	0.28	0.27	0.27			
170	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.22	0.22	0.22	0.22	0.22	0.22	0.22	0.22			
175	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.22			
180	0.21	0.21	0.20	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21	0.21			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.2DEG
 Operators: Oliver
 Test Date: 2018-11-22

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 65.0%
 Test Distance: 2.459m [K=1.0000]
 Remarks: